


Fire test ISO9705
 Viking WarmSpan system is rated 1 - S



***NOTE:**
 If sheet joints are required near Hips, Valleys or Ridges keep Laps 200mm from centre

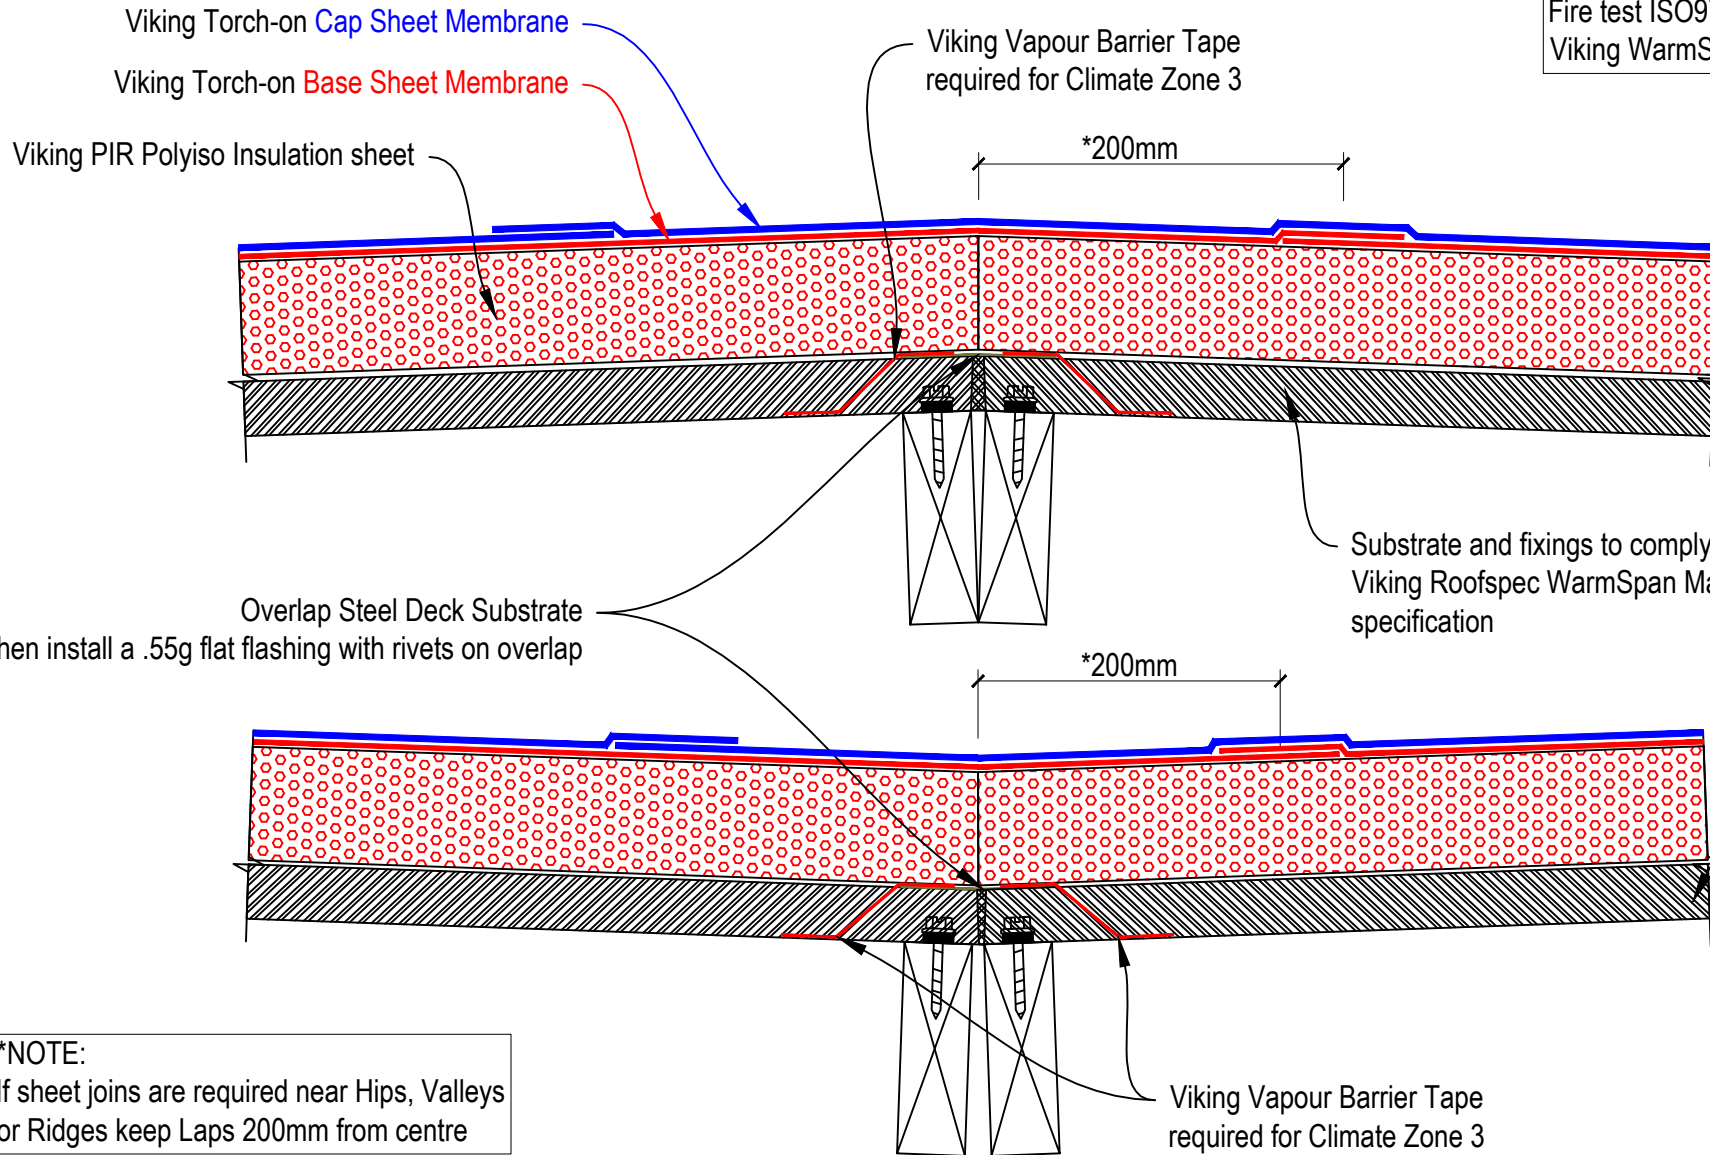

DRAWING TITLE
Viking WarmSpan with Viking Torch-on 2 layer membrane System Hip / Ridge or Valley Detail

NOTES:
Substrate Indicative Only

DRAWING STATUS			
INFORMATION ONLY			
Not to Scale	DATE 05/06/2018	Detail Ref.	ISSUE
DRAWN	Viking	VWS11VT	A